

**Lakeside Pump Station and Force Main  
Mascoutah, Illinois  
ADDENDUM #1  
September 9, 2020**

---

**TO: PROSPECTIVE BIDDERS**

**FROM: City of Mascoutah / Millennia Professional Services**

**PAGES: 1 – 5 (including this sheet)**

The attention of all prospective bidders is directed to the following additions and modifications to the contract documents based on information gathered and questions asked to date.

This addendum forms a part of the bidding and contract documents and modifies the original bidding documents. Receipt shall be acknowledged on the bid form.

This addendum does not change the bid due date of **September 15, 2020 at 2:00 p.m.** Bidder shall remove original bid sheet (004100-3) and replace with the attached in the original bid documents.

---

**Contractor's Proposal Documents**

1. Bid Form, Section 004100, pg. 3, Item No. 1.04:
  - a. Concrete Pad Removal – This item was removed (see attached updated sheet 004100-3 of Bid Documents).
2. Bid Form, Section 004100, pg. 3, Item No. 1.08:
  - a. Ex Planter Removal - This item was removed (see attached updated sheet 004100-3).
3. Bid Form, Section 004100, pg. 3, Item No. 2.03:
  - a. 6" PVC Sewer Laterals – This quantity was increased (see attached updated sheet 004100-3 and exhibit).
4. Bid Form, Section 004100, pg. 3, Item No. 2.11:
  - a. Stone Riprap, Class A3 – This item was added (see attached updated sheet 004100-3 and exhibit)

**Lakeside Pump Station and Force Main**  
**Mascoutah, Illinois**  
**ADDENDUM #1**  
September 9, 2020

---

5. Bid Form, Section 004100, pg. 3, Item No. 3.02:
  - a. Asphalt Pavement – In place of this item, the City will also allow a high-performance cold patch material such as UPM or EZ Street.

These same changes apply to the table in the Contract Documents in the Standard Form of Agreement, 005200-2 (see attached updated sheet 005200-2).

**Drawing Information**

1. Plan Exhibit :
  - a. See the attached exhibit for the updated sewer lateral layout. The quantity is updated under Item No. 2.03 in the Bid Documents (see attached updated sheet 004100-3 of Bid Documents)
  - b. See the attached exhibit for riprap placement and dimensions. The quantity is listed under Item No. 2.11 in the Bid Documents (see attached updated sheet 004100-3 of Bid Documents)
2. Profile Exhibit
  - a. See the attached exhibit for updated invert information on the storm sewer profile. The quantities were not affected by this change.
3. Sheet 10 – Pump Electrical Site Plan
  - a. This note is a clarification on the responsibility of the contractor in regards to the electric and conduit servicing the pump station. The contractor will be responsible for all conduit to 5 feet outside of the pump station fence and all wire to the meter base. The conduit will be empty from the meter base to 5 feet outside the fence. The City will install conduit from 5 feet outside the pump station fence to the power pole, install wire from the power pole to the meter base, make connections, and install the meter.

**Attachments & Notes:**

- A. Reissued Bid Sheet (004100-3 to replace sheet in original bid document)
- B. Plan Exhibit
- C. Profile Exhibit


LAKESIDE ESTATES PUMP STATION AND FORCE MAIN  
MASCOUTAH ILLINOIS

UNIT PRICE BASE BID

ITEM NO.	ITEM DESCRIPTION	QUANTITY	UNIT	UNIT PRICE	TOTAL ITEM PRICE
1.01	Tree Removal, 6"-15"	13	Each		
1.02	Concrete Driveway Pavement Removal	16	Sq Yd		
1.03	Asphalt Pavement Removal	154	Sq Yd		
1.05	Sanitary Sewer Removal, 4" PVC	32	Lin Ft		
1.06	18" CPP Culvert Removal	20	Lin Ft		
1.07	Ornamental Light Removal	1	Each		
2.01	Sanitary Sewer, 8" PVC	71	Lin Ft		
2.02	Sanitary Sewer Force Main, 4" PVC	305	Lin Ft		
2.03	6" PVC Sewer Laterals	52	Lin Ft		
2.04	Sanitary Sewer Manhole	2	Each		
2.05	Sanitary Sewer Cleanout	2	Each		
2.06	Connection to Existing Sewer	2	Each		
2.07	Sanitary Sewer Pump Station	1	Lump Sum		
2.08	Precast Concrete Flared End Sections, 15"	2	Each		
2.09	15" Reinforced Concrete Pipe	48	Lin Ft		
2.10	Trench Backfill	24	Cu Yd		
2.11	Stone Riprap, Class A3	12	Sq Yd		
3.01	Concrete Driveway Pavement	16	Sq Yd		
3.02	Asphalt Pavement	8	Sq Yd		
3.03	Gravel Pavement	121	Sq Yd		
3.04	6' Chain Link Fence (and Gate)	108	Lin Ft		
3.05	Seeding	0.18	Acres		

TOTAL BASE PRICE \_\_\_\_\_ (\$ \_\_\_\_\_ )  
use words (figures)

BIDDER acknowledges that quantities are not guaranteed and final payment will be based on actual quantities determined as provided in the Contract Documents.

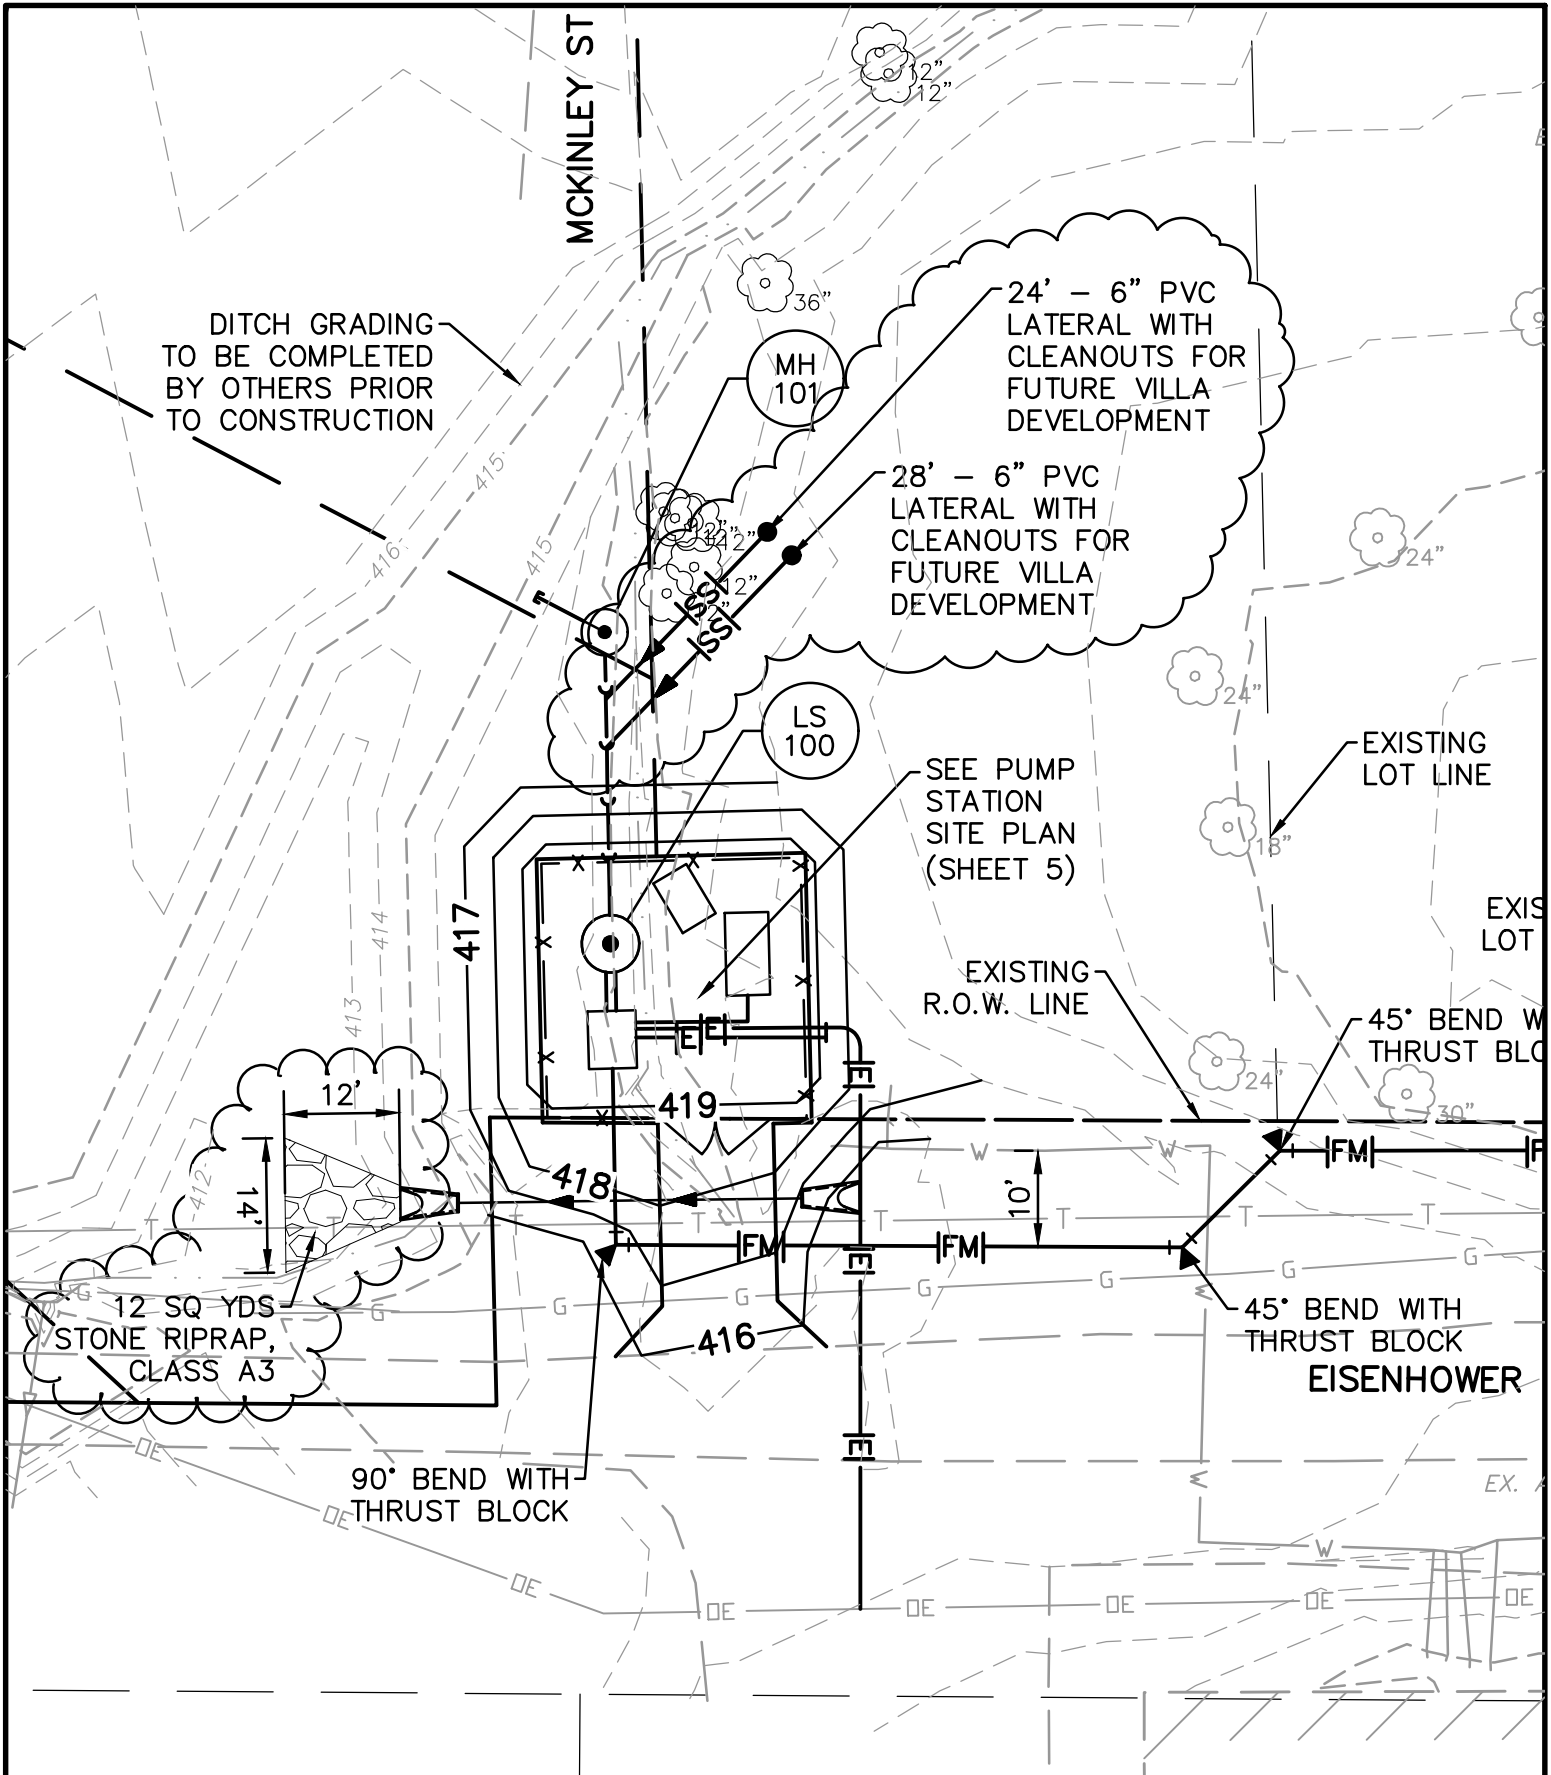

DITCH GRADING  
TO BE COMPLETED  
BY OTHERS PRIOR  
TO CONSTRUCTION

24' - 6" PVC  
LATERAL WITH  
CLEANOUTS FOR  
FUTURE VILLA  
DEVELOPMENT

28' - 6" PVC  
LATERAL WITH  
CLEANOUTS FOR  
FUTURE VILLA  
DEVELOPMENT

SEE PUMP  
STATION  
SITE PLAN  
(SHEET 5)

EXISTING  
LOT LINE

EXIS  
LOT

EXISTING  
R.O.W. LINE

45° BEND W  
THRUST BLO


45° BEND WITH  
THRUST BLOCK  
EISENHOWER

90° BEND WITH  
THRUST BLOCK

12 SQ YDS  
STONE RIPRAP,  
CLASS A3



<b>LAKESIDE ESTATES PUMP STATION PLAN EXHIBIT</b>	
	<b>Millennia Professional Services</b>
	11 Executive Drive, Suite 12 Fairview Heights, Illinois 62208 (618)624-8610 FAX: (618)624-8611
	DRAWN: S.J. CHKD.: T.J.L. APPD.: E.R.O. JOB NO.: ME19039 DATE: 9/9/2020 SHEET 1 OF 1

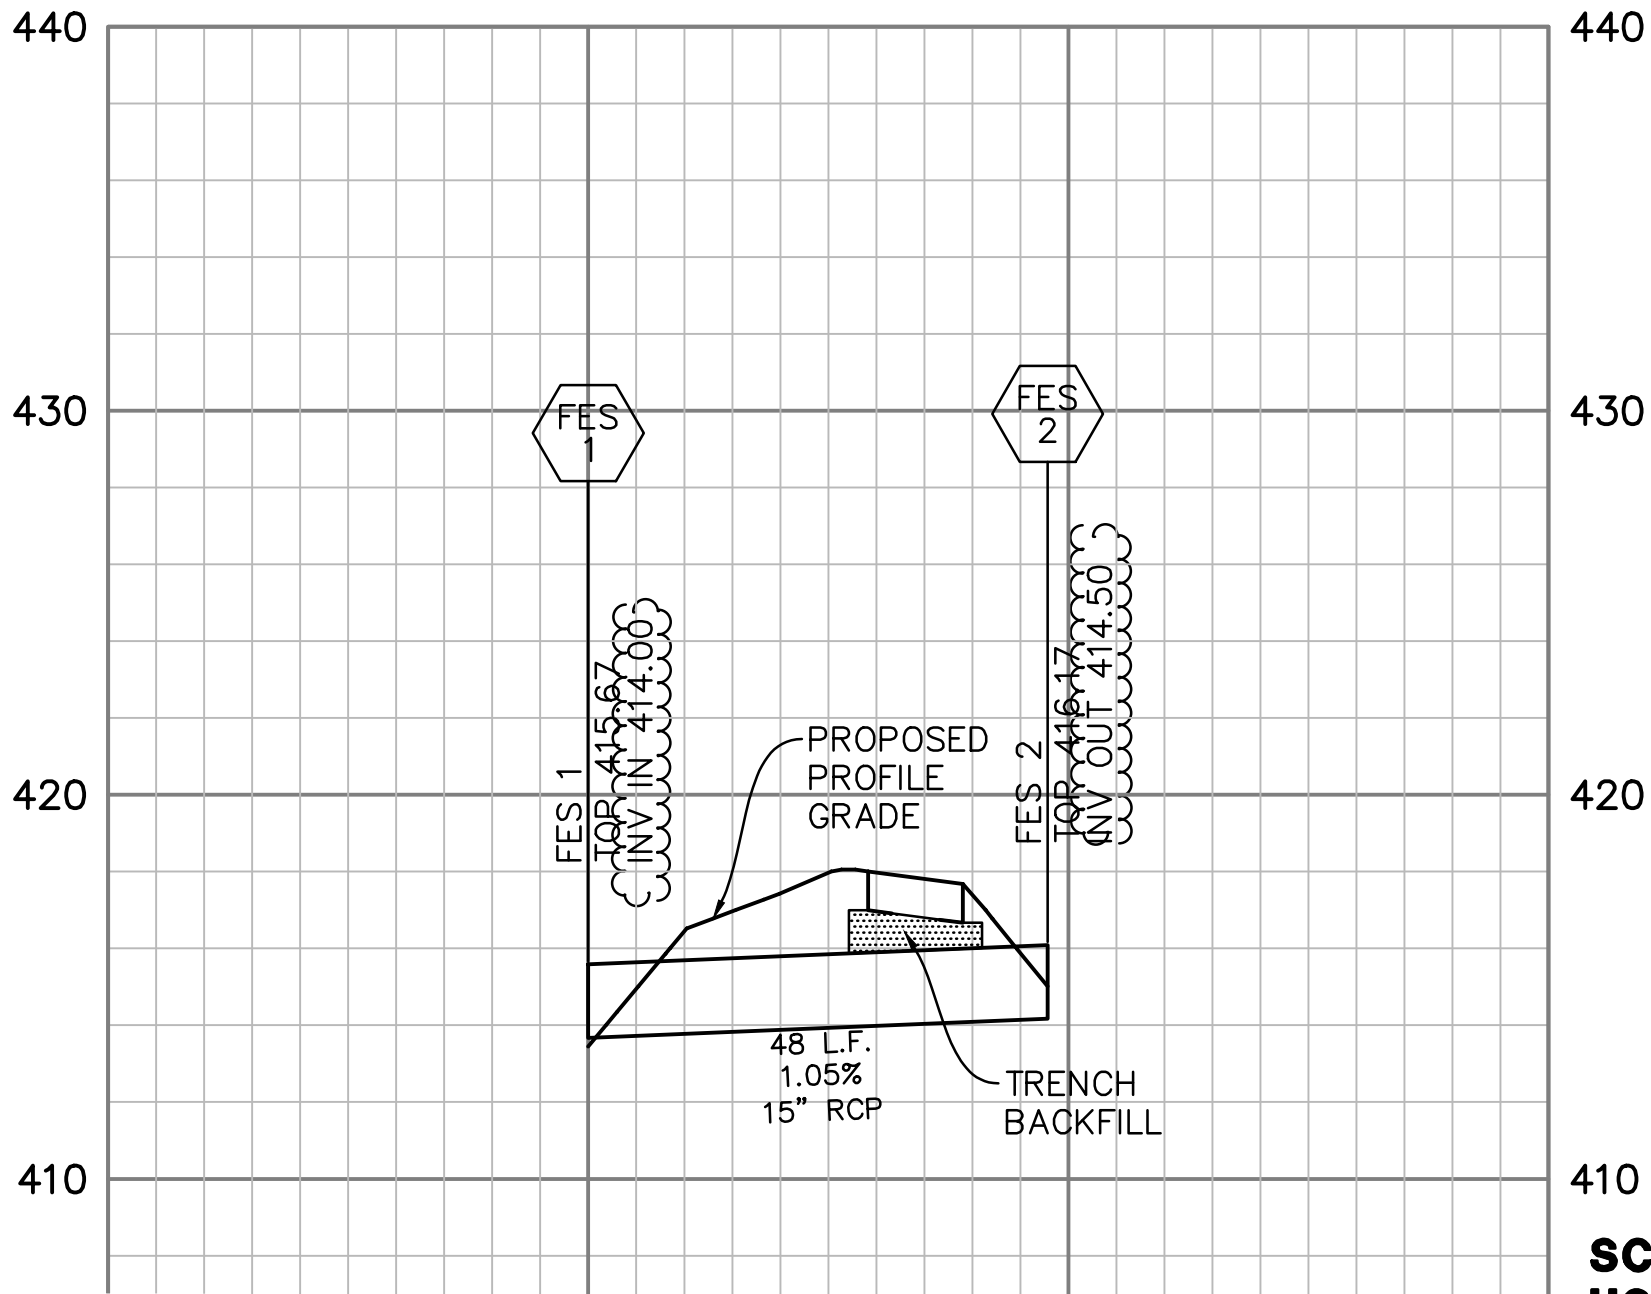

**SCALE**  
**HORIZ. 1"=20'**  
**VERT. 1"=5'**

**LAKESIDE ESTATES PUMP STATION  
PROFILE EXHIBIT**



**Millennia  
Professional Services**  
11 Executive Drive, Suite 12  
Fairview Heights, Illinois 62208  
(618)624-8610 FAX: (618)624-8611

DRAWN: S.J.  
CHKD: T.J.L.  
APPD: E.R.O.  
JOB NO: ME19039  
DATE: 9/9/2020  
SHEET 1 OF 1